Contents

Safety precautions 2
Product specifications 4
Outdoor unit specification 4
Main components 5
Installing the unit 5
Electrical connections 12
Connecting the cable 12
Refrigerant piping work 16
Checking correct grounding 27
Setting the option switch and function of the keys 28
Pump down procedure 30
Completing the installation 33
Final checks and trial operation 34
Trouble shooting 35
Error codes 35

Safety precautions

Carefully follow the precautions listed as below because they are essential to guarantee the safety of SAMSUNG product.

WARNING

- Always disconnect a power supply of Air-Water Heat Pump before servicing it or accessing components inside the unit.
- Verify that installation and testing operations shall be performed by qualified personnel.
- To prevent serious damage on the system and injuries to users, precautions and other notices shall be observed.

Warning

- Carefully read the content of this manual before installing the air to water heat pump and store the manual in a safe place in order to be able to use it as reference after installation.
- For maximum safety, installers should always carefully read the following warnings.
- Store the operation and installation manual in a safe location and remember to hand it over to the new owner if the air conditioner is sold or transferred.
- Store the user and installation manual in a safe location and remember to hand it over to the new owner if the air to water heat pump is sold or transferred.
- This manual explains how to install Air-Water Heat Pump. The use of other types of units with different control systems may damage the units and invalidate the warranty. The manufacturer shall not be responsible for damages arising from the use of non compliant units.
- This product has been determined to be in compliance with the Low Voltage Directive (2006/95/EC), and the Electromagnetic Compatibility Directive (2004/108/EEC) of the European Union.
- The manufacturer shall not be responsible for damage originating from unauthorized changes or the improper connection of electric and hydraulic lines. Failure to comply with these instructions or to comply with the requirements set forth in the "Operating limits" table, included in the manual, shall immediately invalidate the warranty.
- Failure to comply with these instructions or to comply with the requirement on the Operating Range (Heat: -20~35°C/Cool: 10~46°C) set forth in the Product Specification (p.5) shall immediately invalidate the warranty.
- Do not use the units if you see some damages on the units and recognize something bad such as loud noisy, smell of burning.
- In order to prevent electric shocks, fires or injuries, always stop the unit, disable the protection switch and contact SAMSUNG's technical support if the unit produces smoke, if the power cable is hot or damaged or if the unit is very noisy.
- Always remember to inspect the unit, electric connections, refrigerant tubes and protections regularly. These operations shall be performed by qualified personnel only.
- The unit contains moving parts and electrical parts, which should always be kept out of the reach of children.

- Do not attempt to repair, move, alter or reinstall the unit by unauthorized personnel, these operations may cause product damage, electric shocks and fires.
- Do not place containers with liquids or other objects on the unit.
- All the materials used for the manufacture and packaging of the air to water heat pump are recyclable.
- The packing material and exhaust batteries of the remote controller(optional) must be disposed of in accordance with local regulations.
- The air to water heat pump containing a refrigerant must be disposed in authorized center or returned to retailer as special wastes.
- Wear protective gloves to unpack, move, install, and service the unit to avoid your hands being injured by the edge of the parts.
- Do not touch the internal parts (water pipes, refrigerant pipes, heat exchangers, etc) while running the units. And if you need to adjust and touch the units, have enough time for the unit can be cooled and be sure to wear protective gloves.
- In case of refrigerant leakage, try to avoid getting in contact with the refrigerant because this could result in severe wounds.
- When you install the Air to water heat pump in a small room, you must consider a proper ventilation to prevent a leakage level within the maximum permissible limit.
  - In that case, you may die from suffocation by some possibility.
- Make sure to safely dispose of packing materials. Packing materials, such as nails and other metal or wooden pallets may cause children get injured.
- Inspect the product shipped and check if damaged during transport. If the product has some damages, DO NOT INSTALL and immediately discuss about the damages with the carrier or retailer (if the installer or the authorized technician has collected the material from the retailer.)
- Our units shall be installed in compliance with the spaces described in the installation manual, to ensure accessibility from both sides and allow repairs or maintenance operations to be carried out. If the units installed without complying with procedures described in manual, additional expenses can be asked because special harnesses, ladders, scaffolding or any other elevation system for repair service will NOT be considered part of the warranty and will be charged to the end customer.
- Always make sure that the power supply is compliant with local safety standards.
- Verify that the voltage and frequency of the power supply comply with the specifications and input power is sufficient to ensure the operation of any other domestic appliance connected to the same electric lines. Always verify that the cut-off and protection switches are suitably selected.
- Always verify that electric connections (cable entry, section of leads, protections…) are compliant with the electric specifications and with the instructions provided in the wiring scheme. Always verify that all connections comply with the standards applicable to the installation of air to water heat pumps. Devices disconnected from the power supply should be completely disconnected in the condition of overvoltage category.
- Do not connect the earth wire to the gas pipe or water pipe, lighting rod, surge absorber, or telephone earth wire. If earthing is not complete, it may cause an electric shock or fire.
- Be sure to install both an earth leakage detector and circuit breaker with specified capacity in accordance with relevant local and national regulations.
  - If it is not installed properly, it may cause electric shocks and fire.
- Make sure that the condensed water runs well out of the unit at low ambient temperature. Drain pipe and cond heater can frost/ice can not grow. If drain work is not effective for releasing condensed water, it can make the units get damaged by massive ice and system can be stop , covered by ice.
- Install the power cable and communication cable of the indoor and outdoor unit at least 1m away from the electric appliance.
- Protect the unit from rats or small animals. If an animal makes a contact with the electric parts, it can cause malfunctions, smoke or fire. Please instruct the customer to keep the area around the unit clean.

Product specifications

Product line-up

Line-up			Remark
Heat pump units	Chassis		-
	Model name	AEX060EDEHA	

Accessories

- Keep supplied accessories until the installation is finished.
- Hand the installation manual over to the customer after finishing installation.
- The quantities are indicated in parentheses.

Installation manual (1)	Drain plug (1)	Nipple-Connetor(1)	Rubber Leg(4)

Outdoor unit specification

Type	Unit	AEX060EDEHA
Power source	-	1P, 220~240VAC 50Hz
Compressor	-	Rotary Inverter
Condenser	-	Ø7, L906
Fan & Motor	-	Propeller, Ø420,3-blade,BLDC Inverter
Refrigerant	kg	1.2
Noise (Heat/Cool, Pressure)	dBA	53 / 54
Operating range (Heat/Cool)	℃	-20~35 / 10~46
Leaving water temperature	℃	Cooling : 5 ~ 25 Heating : 25 ~ 55
Weight (net/gross)	kg	47.5/52.5
Size (WxHxD, net)	mm	880X638X310

Main components

Dimensions(Overall)

Heat pump for R-410A.



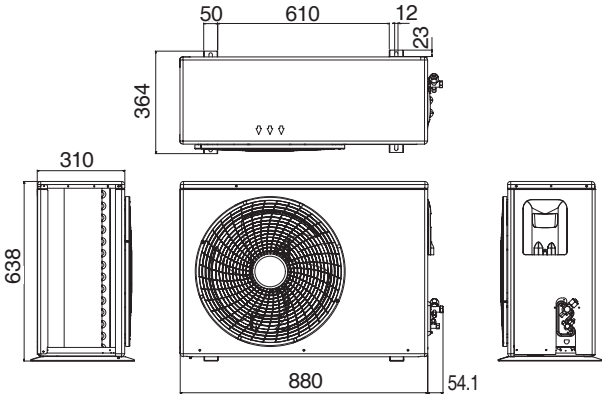

Installing the unit

Deciding on where to install the outdoor unit

Decide the installation location regarding the following condition and obtain the user's approval.

- The outdoor unit must not be placed on its side or upside down, as the compressor lubrication oil will run into the cooling circuit and seriously damage the unit.
- Choose a location that is dry and sunny, but not exposed to direct sunlight or strong winds.
- Do not block any passageways or thoroughfares.
- Choose a location where the noise of the Air to Water Heat Pump when running and the discharged air do not disturb any neighbours.
- Choose a position that enables the pipes and cables to be easily connected to the other hydrauric system.
- Install the outdoor unit on a flat, stable surface that can support its weight and does not generate any unnecessary noise and vibration.
- Position the outdoor unit so that the air flow directly stream towards the open area.
- Place the outdoor unit where there are no plants and animals because they may cause malfunction of outdoor unit.
- Maintain sufficient clearance around the outdoor unit, especially from a radio, computer, stereo system, etc.
- When installing the outdoor unit near seashore, make sure it is not directly exposed to sea breeze. If you can not find an adequate place without direct sea breeze, make sure to apply anti-corrosion coating on the heat exchanger.

Installing the unit

▶ Install the outdoor unit in a place (such as near buildings etc.) where it can be prevented from sea breeze which can damage the outdoor unit.

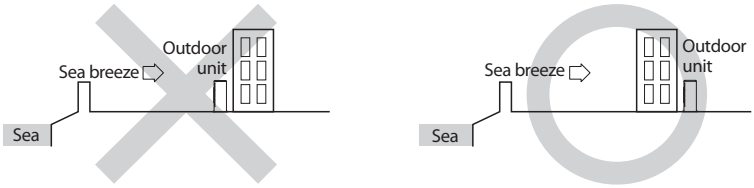

▶ If you cannot avoid installing the outdoor unit by the seashore, construct a protection wall around to block the sea breeze.

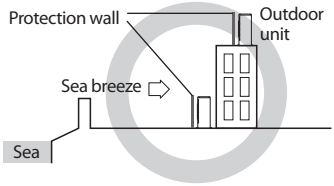

- Protection wall should be constructed with a solid material such as concrete to block the sea breeze and the height and the width of the wall should be 1.5 times larger than the size of the outdoor unit. Also, secure over 700mm between the protection wall and the outdoor unit for exhausted air to ventilate.

▶ Install the outdoor unit in a place where water can drain smoothly.

* If you cannot find a place satisfying above conditions, please contact manufacturer. Make sure to clean the sea water and the dust on the outdoor unit heat exchanger.

▶ Do not install the Air to Water Heat Pump in following places.

- The place where there is mineral oil or arsenic acid. There is a chance that parts may get damaged due to burned resin. The capacity of the heat exchanger may reduce or the Air to Water Heat pump may be out of order.
- The place where corrosive gas such as sulfurous acid gas generates from the vent pipe or air outlet. The copper pipe or connection pipe may corrode and refrigerant may leak.
- The place where there is a danger of existing combustible gas, carbon fiber or flammable dust. The place where thinner or gasoline is handled.

CAUTION

- Do not install the outdoor unit in a snowy and cold area (low temperature and high humidity area - where the temperature is below -7°C and humidity is higher than 85%) because according to operation condition (defrost, etc.), ice may be formed in the drain route.
  If the ice is accumulated, it may cause critical damage to the product.
  ex) lakeside of cold area in winter time, seashore, alpine region and etc.

CAUTION

- This device must be installed according to the national electrical rules.
- With an outdoor unit having net weight upper than 60kg, we suggest do not install it suspended on wall, but considering floor standing one.

▶ If the outdoor unit is installed at a height, ensure that its base is firmly fixed in position.

▶ Make sure that the water dripping from the drain hose runs away correctly and safely.

▶ When you install the outdoor unit at wayside, you should install it above 2m height or make sure that the heat from the outdoor unit shouldn't be in direct contact with passersby. (The ground for application :The revision of regulation for facility in building by the law of the Ministry of Construction and Transportation.

Space requirements for outdoor unit

When installing 1 outdoor unit

(Unit : mm)



* When the air outlet is opposite the wall

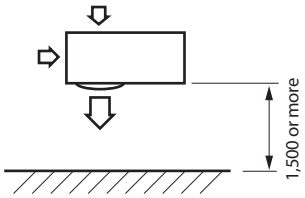

* When the air outlet is towards the wall

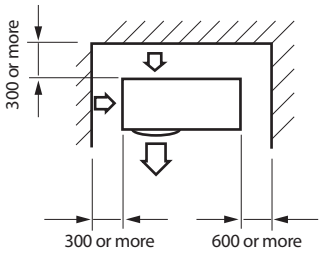

* When 3 sides of the outdoor unit are blocked by the wall



* The upper part of the outdoor unit and the air outlet is towards the wall



* The upper part of the outdoor unit and the air outlet is opposite the wall



* When front and rear side of the outdoor unit is towards the wall

Installing the unit

When installing more than 1 outdoor unit

(Unit : mm)

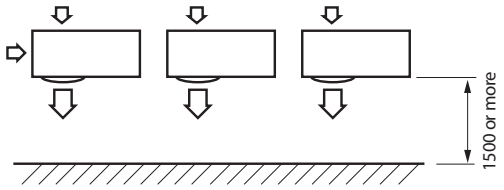

* When the air outlet is towards the wall

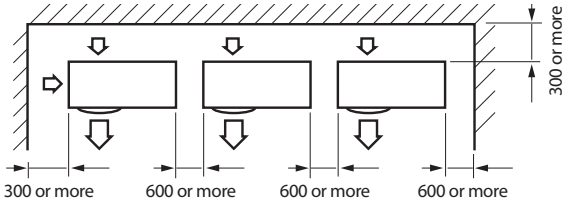

* When 3 sides of the outdoor unit are blocked by the wall

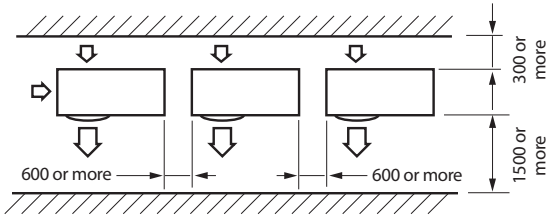

* When front and rear side of the outdoor unit is towards the wall

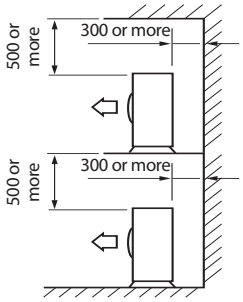

* The upper part of the outdoor unit and the air outlet is opposite the wall

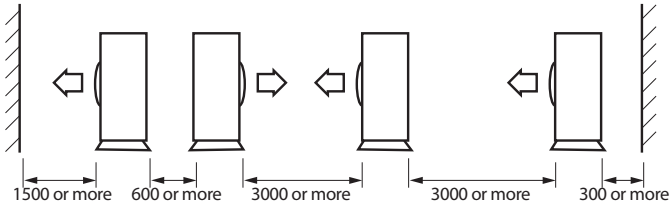

* When front and rear side of the outdoor unit is towards the wall

CAUTION

- The units must be installed according to distances declared, in order to permit accessibility from each side, either to guarantee correct operation of maintenance or repairing products. The unit's parts must be reachable and removable completely under safety condition (for people or things).

Outdoor unit installation

The outdoor unit must be installed on a rigid and stable base to avoid any increase in the noise level and vibration, particularly if the outdoor unit is to be installed in a location exposed to strong winds or at a height, the unit must be fixed to an appropriate support(wall or ground).

► Fix the outdoor unit with anchor bolts.

(Unit : mm)

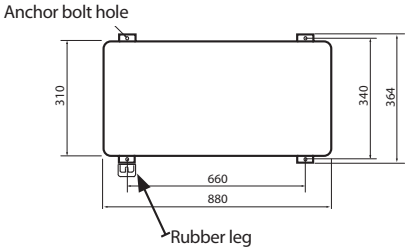

NOTE
- The anchor bolt must be 20mm or higher from the base surface.

CAUTION
- When tightening the anchor bolt, tighten the rubber washer to prevent the outdoor unit bolt connection part from corroding.
- Make a drain outlet around the base for outdoor unit drainage.
- If the outdoor unit is installed on the roof, you have to check the ceiling strength and waterproof the unit.

Outdoor unit support

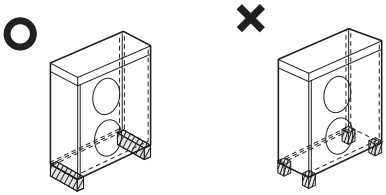

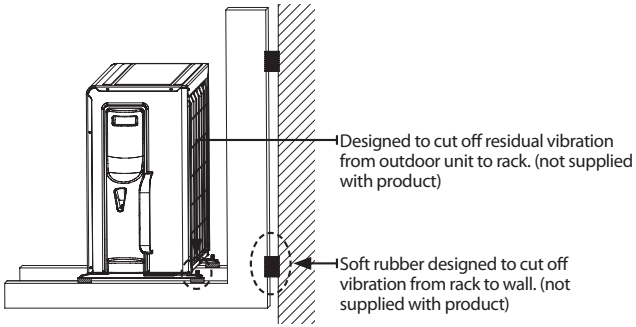
Designed to cut off residual vibration from outdoor unit to rack. (not supplied with product)
Soft rubber designed to cut off vibration from rack to wall. (not supplied with product)

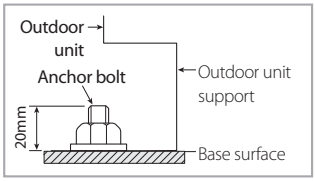

► Outdoor unit installed on the wall by rack
- Ensure the wall will be able to suspend the weight of rack and outdoor unit ;
- Install the rack close to the column as much as possible ;
- Install proper grommet in order to reduce noise and residual vibration transferred by outdoor unit towards wall.

CAUTION
When installing air guide duct
- Check and make sure that screws do not damage the copper pipe.
- Secure air guide duct on guard fan.

Installing the unit

Drain work

While Air-Water Heat Pump is running in heating mode, Ice can begin accumulate on the surface of condenser. To prevent Ice from growing, system go into De-frost mode and then Ice on the surface changes to water.
Dropped water from condenser shall be eliminated through running drain holes to prevent Ice growing at low temperature.

- In case there is not enough space for drainage out of the unit, additional drain works are required. Follow the description as below
  - Make space more than 50mm between the bottom of the outdoor unit and the ground for installation of the drain hose.
  - Insert the drain plug into the hole on the bottom of the outdoor unit.
  - Connect the drain hose to the drain plug.
  - Make sure dusts or small branches should not go into the drain hose.

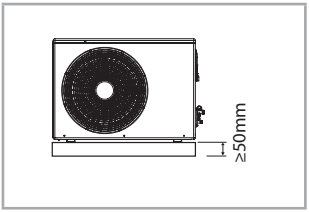

WARNING • If drain work is not enough, it can lead to system performance degration and system damages.

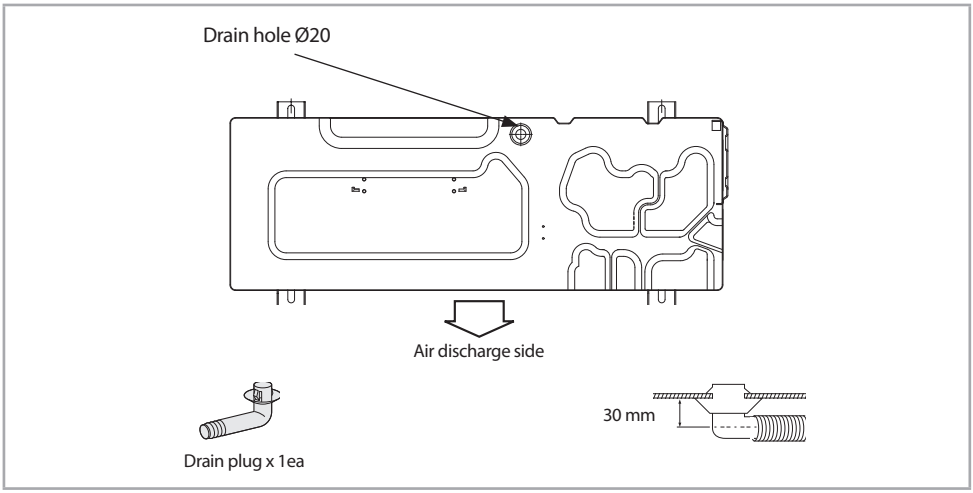

1. Prepare a water drainage channel around the foundation, to drain waste water from around the unit.
2. If the water drainage of the unit is not easy, please build up the unit on a foundation of concrete blocks, etc. (the height of the foundation should be maximum 150mm).
3. If you install the unit on a frame, please install a waterproof plate within 150mm of the underside of the unit in order to prevent the invasion of water from the lower direction.
4. When installing the unit in a place frequently exposed to snow, pay special attention to elevate the foundation as high as possible.
5. If you install the unit on a building frame, please install a waterproof plate (field supply) (within 150mm of the underside of the unit) in order to avoid the drain water dripping. (See figure)



Selecting a location in cold climates

NOTE

- When operating the unit in a low outdoor ambient temperature, be sure to follow the instructions described below.

- To prevent exposure to wind, install the unit with its suction side facing the wall.
- Never install the unit at a site where the suction side may be exposed directly to wind.
- To prevent exposure to wind, install a baffle plate on the air discharge side of the unit.
- In heavy snowfall areas it is very important to select an installation site where the snow will not affect the unit. If lateral snowfall is possible, make sure that the heat exchanger coil is not affected by the snow (If necessary construct a lateral canopy)



1. Construct a large canopy.
2. Construct a pedestal.
   - Install the unit high enough off the ground to prevent it being buried under snow.

- The fan inside outdoor unit will operate regularly, as designed, with switch 2 to prevent from snow accumulating inside outdoor unit. (Refer to page 29)
- The outdoor unit should be installed with consideration of the direction of strong winds. These can make the unit turn over, so the side of the unit should be set to face the wind, not the front of the unit.

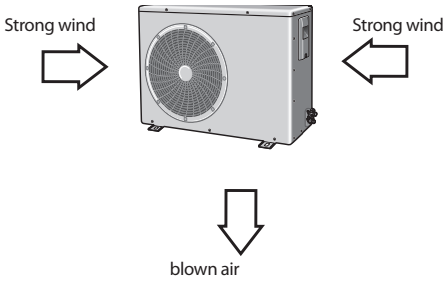

Electrical connections

Overall system configuration

Connection of the power cable (1 phase 2 wires)

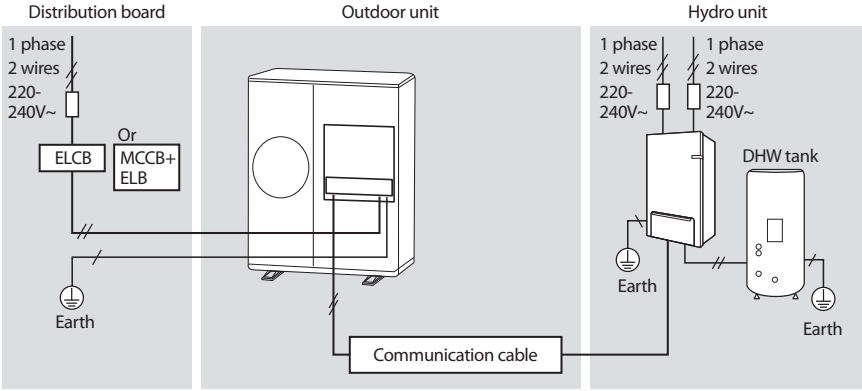

CAUTION
- Install cabinet panel near the outdoor unit for the convenience of service and emergency operation off.
- Make sure to install the circuit breaker with the over-current and electric leakage protection.

Connecting the cable

Power cable specifications

1 phase

Outdoor unit	Rated		Voltage Range		MCA	MFA	Fuse cut-off current
	Hz	Volts	Min	Max	Maximum Current in normal operation	MCA✳1.25 + Additional Load	Total fuse in unit
AEX060EDEHA	50	220-240	198	264	20 A	25 A	30 A

- ▶ The power cable is not supplied with air conditioner.
- ▶ Supply cords of parts of appliances for outdoor use shall not be lighter than polychloroprene sheathed flexible cord (Code designation IEC:60245 IEC 57 / CENELEC:H05RN-F)
- ▶ Equipment complying with EN/IEC 61000-3-12.

WARNING
- In case of extending the electric wire, please DO NOT use a round-shaped pressing socket.
  - Incomplete wire connections can cause electric shock or a fire.



Connecting the cable

Between indoor unit and outdoor unit connection cable specifications(common in use)

Power supply			Communation cable
Power supply	Max/Min(V)	Indoor power cable	
1Φ, 220-240V, 50Hz	±10%	0.75~1.5mm², 3wires	0.75~1.5mm², 2wires

► For Indoor Power Cable, use the grade H07RN-F or H05RN-F materials.



When installing the indoor unit in a computer room or net work room, use the double shielded (Tape aluminum / polyester braid + copper) cable of FROHH2R type.

1-phase terminal block spec

AC power : M4 screw



Communication : M4 screw



Wiring diagram of power cable

When using ELB for 1 phase

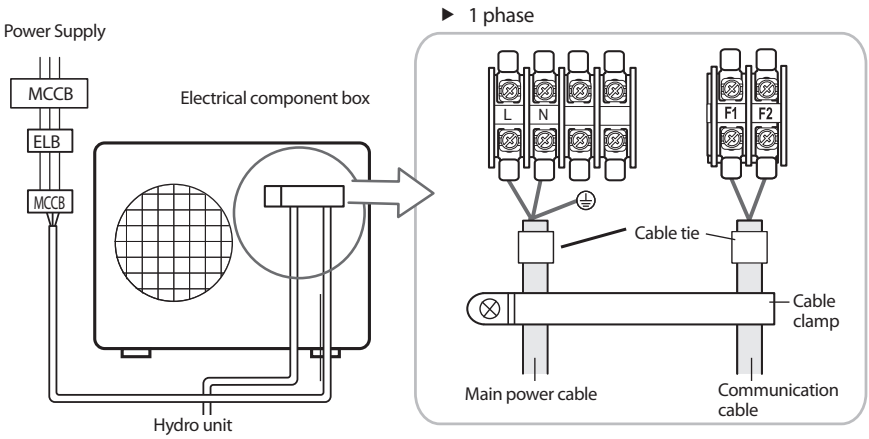

* The appearance of the unit may be different from the picture depending on the model.

Connecting the cable

CAUTION

- You should connect the power cable into the power cable terminal and fasten it with a clamp.
- The unbalanced power must be maintained within 2% of supply rating.
  - If the power is unbalanced greatly, it may shorten the life of the condenser. If the unbalanced power is exceeded over 4% of supply rating, the indoor unit is protected, stopped and the error mode indicates.
- To protect the product from water and possible shock, you should keep the power cable and the connection cord of the indoor and outdoor units within ducts. (with appropriate IP rating and material selection for your application)
- Ensure that main supply connection is made through a switch that disconnects all poles, with contact gap of a least 3 mm.
- Devices disconnected from the power supply should be completely disconnected in the condition of overvoltage category.
- Keep distances of 50mm or more between power cable and communication cable.

1 phase 2 wires (220-240V~)

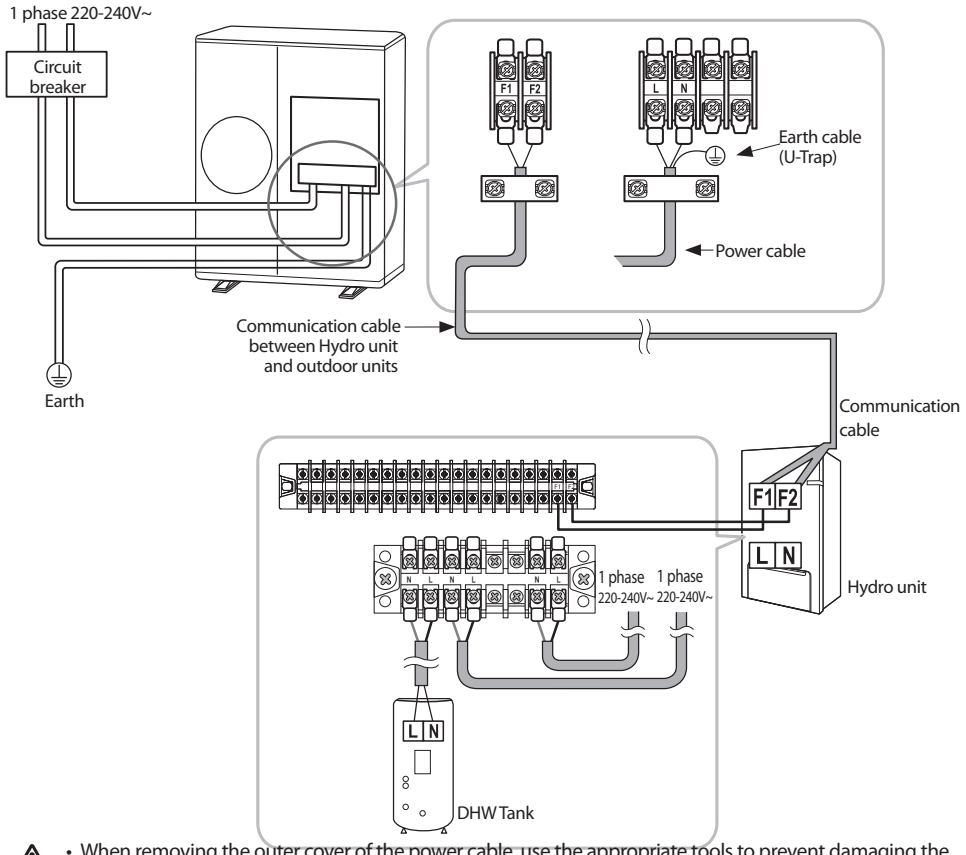

CAUTION

- When removing the outer cover of the power cable, use the appropriate tools to prevent damaging the inner cover.
- Make sure to place the outer cover of the power cable and the communication cable, at least 20mm into the electrical parts.
- Communication wiring should be done separately from the power cable and other communication cables.

Connecting the power terminal

- Connect the cables to the terminal board using the compressed ring terminal.
- Connect the rated cables only.
- Connect using a wrench which is able to apply the rated torque to the screws.
- If the terminal is loose, fire may occur caused by arc. If the terminal is connected too firmly, the terminal may be damaged.

Tightening Torque (kgf.cm)	
M4	12.0~14.7
M5	24.4~29.8

Installing the earth wire

- Earthing must be done by your installation specialist for your safety.
- Use the earth wire by referring to the specification of the electric cable for the outdoor unit.

Earthing the power cable

- The standard of earthing may vary according to the rated voltage and installation place of the Air to Water Heat Pump.
- Earth the power cable according to the following.

Installation place / Power condition	High humidity	Average humidity	Low humidity
Electrical potential of lower than 150V		Perform the earthing work 3. Note 1)	Perform the earthing work 2 if possible for your safety. Note 2)
Electrical potential of higher than 150V	Must perform the earthing work 3. Note 1) (In case of installing circuit breaker)		

* Note 1) Earthing work 3
- Earthing must be done by your installation specialist.
- Check if the earthing resistance is lower than 100Ω. When installing a circuit breaker that can cut the electric circuit in case of a short circuit, the allowable earthing resistance can be 30~500Ω.

* Note 2) Earthing at dry place
- The earthing resistance should be lower than 100Ω. (Even in worst case it should be lower than 250Ω.)

▶ When using the terminal for earthing only



▶ When using earthing of the switchboard



Refrigerant piping work

- ▶ Install the refrigerant pipe within the maximum allowable length, difference in height and length of after the first branch pipe.
- ▶ The pressure of the R-410A is high.
  Use only rated refrigerant pipe and follow the installation method.
- ▶ Use clean refrigerant pipe Where there is no harmful ion, oxide, dust, iron content or moisture.
- ▶ Use adequate tools and accessories for R-410A.

Manifold gauge	• Use manifold gauge only for R-410A to prevent the inflow of foreign substances.
Vacuum pump	• Use vacuum pump with check valve to prevent pump oil from flowing backward while the vacuum pump is stopped. • Use the vacuum pump that the vacuum induction is available up to 5Torr. (-100.7kPa)
Flare nut	• Use only flare nut supplied with the product.

Allowable length of the refrigerant pipe and the installation examples

- ▶ AEX060EDEHA,

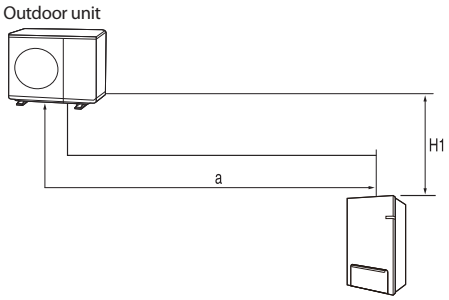

Item				Example	Remarks
Maximum allowable length of pipe	Outdoor unit ~ Hydro unit	Total length	Less than 30m	a ≤ 30m	
Maximum allowable height	Outdoor unit ~ Hydro unit	Less than 20m		H1	
Additional refrigerant calculation	R=Basic charge + additional charge by the piping length				

Contact the manufacturer if the length should exceed.

Selecting the refrigerant pipe

Outdoor unit capacity (kW)	Liquid side (mm)	Gas side (mm)
AEX060EDEHA	ø6.35	ø15.88

- Install refrigerant pipe depending on the outdoor unit capacity.
- Make sure to use C1220T-1/2H (Semi-hard) pipe for more than Ø19.05mm. In case of using C1220T-O (Soft) pipe for Ø19.05mm, pipe may be broken, which can result in an injury.

Outer diameter (mm)	Minimum thickness (mm)	Temper grade
ø 6.35	0.7	C1220T-0
ø 9.52	0.7	
ø12.70	0.8	
ø15.88	1.0	
ø15.88	0.8	C1220T-1/2H OR C1220T-H
ø19.05	0.9	
ø22.23	0.9	

* Temper grade and minimum thickness of the refrigerant pipe

Keeping refrigerant pipe clean and dry

- To prevent foreign materials or water from entering the pipe, pipes shall be sealed by caps.

Installing the Nipple

- Before connecting the refrigerant pipe, the Nipple must be connected to liquid side pipe of Hydro unit.

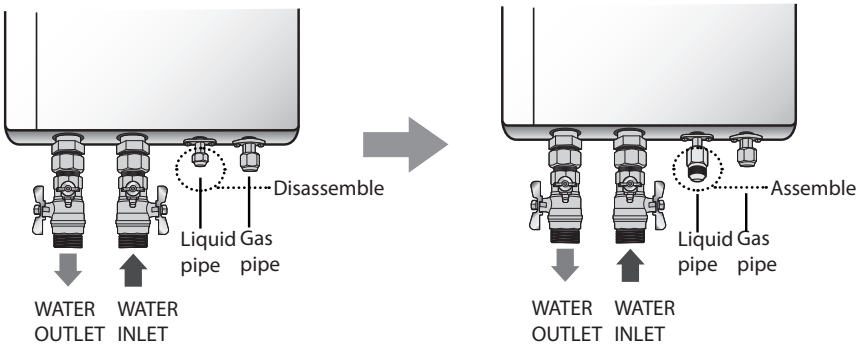

Refrigerant piping work

Cutting or flaring the pipes

1. Make sure that you prepared the required tools.
   - Pipe cutter, reamer, flaring tool and pipe holder, etc.
2. If you want to shorten the pipe, cut it with a pipe cutter ensuring that the cut edge remains at 90° with the side of the pipe.
   - There are some examples of correct and incorrect cut edges below.



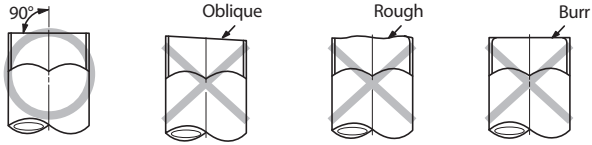

3. To prevent a gas leak, remove all burrs at the cut edge of the pipe with a reamer.

CAUTION
- Face the pipe down while removing the burrs to make sure that burrs do not get in to the pipe.



4. Put a flare nut slightly into the pipe and modify the flare.

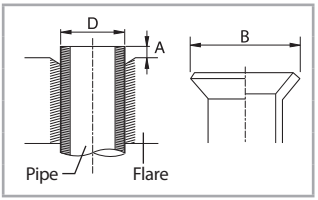

Outer diameter [D(mm)]	Depth [A (mm)]	Flaring Size [B (mm)]
ø 6.35	1.3	9.0
ø 9.52	1.8	13.0
ø 12.70	2.0	16.2
ø 15.88	2.2	19.3
ø19.05	2.2	22.5

5. Check that you flared the pipe correctly.
   - Below figures shows some examples of incorrectly flared pipes.

Correct | Inclined | Damaged surface | Cracked | Uneven thickness

6. Align the pipes to connect them easily. Tighten the flare nuts first with your hands, and then with a torque wrench, applying the following torque:

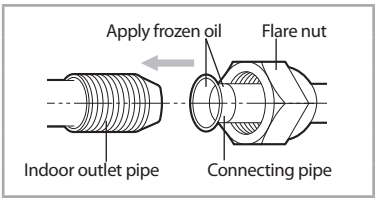

Outer diameter (mm)	Torque (N•m)
ø 6.35	12~17
ø 9.52	30~35
ø 12.70	40~45
ø 15.88	50~60
ø19.05	60~70

NOTE
- Excessive torque can be cause of gas leakage.

CAUTION
- You must purge with oxygen free nitrogen while brazing.

Selecting the insulator of the refrigerant pipe

- ▶ According to pipes size, insulate pipes on gas and liquid side by selecting appropriate insulations.
- ▶ Standard condition is under a temperature of 30°C and a humidity of 85%. If the units are installed in extreme weather conditions, select the insulator by table below.

Pipe type	Pipe diameter (mm)	Thickness of insulator		Remarks
		Normal (Under 30°C, 85%)	High humidity (Over 30°C, 85%)	
		EPDM, NBR		
Liquid	ø6.35~ø19.05	9	9	The material shall has heat resistant over 120°C
	ø12.70~ø19.05	13	13	
Gas	ø6.35	13	19	
	ø9.52	19	25	
	ø12.70			
	ø15.88			
	ø19.05			

CAUTION

- Install the insulation not to be get wider and use the adhesives on the connection part of it to prevent moisture entering.
- Wind the refrigerant pipe with insulation tape if it is exposed to outside sunlight.
- Install the refrigerant pipe respecting that the insulation does not get thinner on the bent part or hanger of pipe.

Refrigerant piping work

Insulating the refrigerant pipe

- You must check if there is a gas leak before completing all the installation process.
- Use EPDM insulation which meets the following condition.

Item	Unit	Standard	Remarks
Density	g/cm^2	0.048~0.096	KSM 3014-01
Dimension change route by heat	%	-5 or less	
Water absorption rate	g/cm^2	0.005 or less	
Thermal conductivity	kcal/m·h·°C	0.032 or less	KSL 9016-95
Moisture transpiration factor	ng/(m^2·s·Pa)	15 or less	KSM 3808-03
Moisture transpiration grade	{g/(m^2·24h)}	15 or less	KSA 1013-01
Formaldehyde dispersion	mg/L	-	KSF 3200-02
Oxygen rate	%	25 or less	ISO 4589-2-96

Insulating the refrigerant pipe

- Be sure to insulate the refrigerant pipe, joints and connections with class 'o' material.
- If you insulate the pipes, the condensed water does not fall from the pipes and the capacity of the Air to Water Heat Pump is improved.
- Check if there are any insulation cracks on the bent pipe.

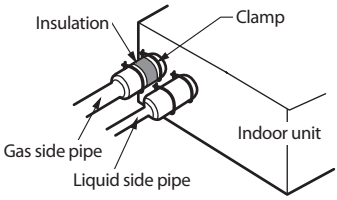

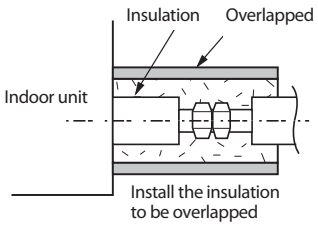

Brazing the Pipe

- Make sure that there is no moisture inside the pipe.
- Make sure that there are no foreign materials and impurities in the pipe.

Replacement of Nitrogen gas

1. Use oxygen free nitrogen gas when brazing the pipes as shown in the picture.
2. If you do not use Nitrogen gas when brazing the pipes, oxidation may form in the pipe. It can cause the damage of the compressor and valves.
3. Adjust the flow rate of the replacement with a pressure regulator to maintain 0.05m^3/h or more.
4. Perform brazing of the service valve after protecting the valve.

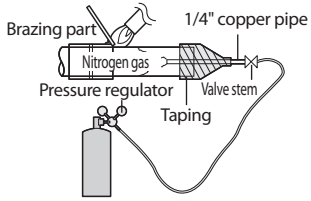

Performing the refrigerant gas leak test

- Use a manifold gauge for R-410A to prevent the inflow of foreign substances and resist against the internal pressure.
- Pressure test with dry oxygen free nitrogen only.

Apply pressure to the liquid side pipe and gas side pipe with Nitrogen gas of 4.1 MPa (41.8 kgf/cm^2)	If you apply pressure more than 4.1MPa, the pipes may be damaged. Apply pressure using pressure regulator.
Keep it for minimum 24 hours to check if the pressure drops.	After applying Nitrogen gas, check the change of pressure using pressure regulator.
If the pressure drops, check if there is gas leak.	If the pressure is changed, apply soapy water to check the leak. Check the pressure of the Nitrogen gas again.
Maintain 1.0MPa of the pressure before performing vacuum drying and check further gas leak.	After checking first gas leak, maintain 1.0MPa to check further gas leak.

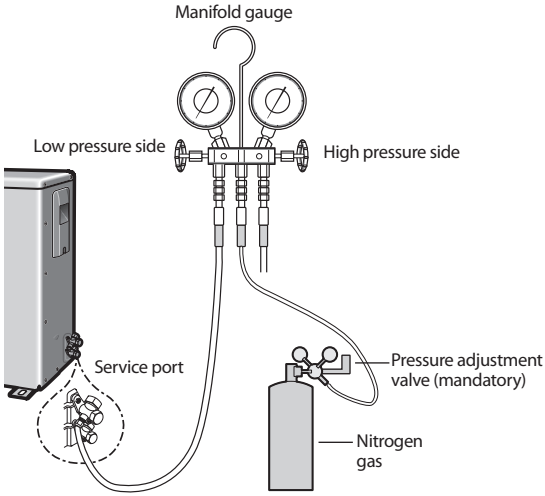

* Make sure to use a recommended bubble test solution for Gas Leak Test. Soap water could cause cracking of the flare nuts or lead to corrosion of flared joints.

CAUTION

- You may get injured when the joint on the high pressure side detaches and the gas comes in contact with your body. Make sure to tighten the joint to prevent such accidents.

Refrigerant piping work

Vacuum drying

- Use a manifold gauge for R-410A to prevent the inflow of foreign substances and resist against the internal pressure.
- Use the vacuum pump with the check valve to prevent pump oil from flowing backward while the vacuum pump is stopped.
- Vacuum system to 5Torr. (666.6Pa, 0.0067 kgf/cm^2, 5 mmHg)
- Close the service valve of the liquid side pipe and gas side pipe completely.

Connect the gauge manifold to the liquid side pipe, gas side pipe and oil balancing pipe(only for module).

Connect the gauge manifold to the oil balancing pipe.



Perform vacuum drying of the liquid side pipe, gas side pipe and oil balancing pipe(only for module) using the vacuum pump.

Make sure that install check valve to prevent pump oil from flowing into the pipe.

While the vacuum gauge pressure is less than 5Torr, perform the vacuum drying for more than 1 hour and then close the valve.

Check the vacuum pressure using the vacuum gauge.

After vacuum pump stops, check whether the pressure is maintained within 5Torr for an hour.

More than 5Torr

Yes

Check the gas leak again.- The pressure rises because water is remaining in the pipe.

Vacuum destruction
- Apply pressure with Nitrogen gas of 0.05MPa.

Perform vacuum drying again up to 666.6Pa(5mmHg) (for 2 hours or longer) and evaluate the vacuum.

Pressure Increase

Yes

No

No

Charging additional refrigerant according to piping length

CAUTION

- If the pressure rises in an hour, either water remains inside the pipe, or there will be a leak.

Selecting additional refrigerant charge

* Basic charge

The basic amount of refrigerant for outdoor unit charged in factory is:

Outdoor unit (Series)	Factory charge(kg)
AEX060EDEHA	1.2

* Charge additional refrigerant according to the total length of the pipe.
  Each factory charging values are determined according to basic pipe length as below.
  AEX060EDEHA ≤ 5m
  When extra pipe length are required, additional charging works must be implemented as describes below.

► Depends on the total length of the liquid side pipe.

- Air to Water

Additional Charge(g) = {(L1-5)x20}+{(L2-5)x50}

NOTE

• L1: Total length of liquid pipe Ø 6.35(m)
  L2: Total length of liquid pipe Ø 9.52(m)

Refrigerant Charging

* Additional charging amount is determined based on liquid pipe specifications.

Outdoor unit of liquid	ø6.35	ø9.52
Additional charging (g)	20g/m	50g/m

Additional charging amount = (sum of total length (m) of ø9.52) × 50g + (sum of total length (m) of ø6.35) × 20g
Ex) 20m × 50g/m + 20m × 20g/m = 1,400g

Refrigerant piping work

Charging refrigerant

- The R-410A refrigerant is blended refrigerant. Add only liquid refrigerant.
- Measure the quantity of the refrigerant according to the length of the liquid side pipe. Add quantity of the refrigerant using a scale.

Important information regulation regarding the refrigerant used

This product contains fluorinated greenhouse gases covered by the Kyoto Protocol. Do not vent gases into the atmosphere.

CAUTION

- Inform user if system contains 3kg or more of fluorinated greenhouse gases. In this case, it has to be checked for leakage at least once every 12 months, according to regulation N°842/2006. This activity has to be covered by qualified personnel only.
- In case situation above (3kg or more of R-410A), installer (or recognized person which has responsibility for final check) has to provide a maintenance book, with all the information recorded according to REGULATION (EC) N° 842/2006 OF THE EUROPEAN PARLIAMENT AND OF THE COUNCIL of 17 May 2006 on certain fluorinated greenhouse gases.

Please fill in with indelible ink,

- ① The factory refrigerant charge of the product.
- ② The additional refrigerant amount charged in the field.
- ①+② The total refrigerant charge.

  The refrigerant charge label supplied with the product.

Refrigerant type	GWP value
R-410A	1975

* GWP=Global Warming Potential

Contains fluorinated greenhouse gases covered by the Kyoto Protocol.

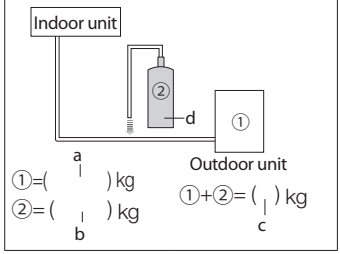

NOTE

a Factory refrigerant charge of the product: See unit name plate.
b Additional refrigerant amount charged in the field. (Refer to the above information for the quantity of refrigerant replenishment.)
c Total refrigerant charge.
d Refrigerant cylinder and manifold for charging.

- Before charging, check whether the refrigerant cylinder has a siphon attached or not and position the cylinder accordingly.

Charging using a cylinder with a siphon attached
Charge the liquid refrigerant with the cylinder in upright position.



Charging using a cylinder without a siphon attached
Charge the liquid refrigerant with the cylinder in up-side-down position.

Adding refrigerant

- The R-410A refrigerant is blended refrigerant. Add only liquid refrigerant.
- Measure the quantity of the refrigerant depending on the length of the liquid side pipe. Add fixed quantity of the refrigerant using a scale.

* Adding refrigerants in cooling conditions

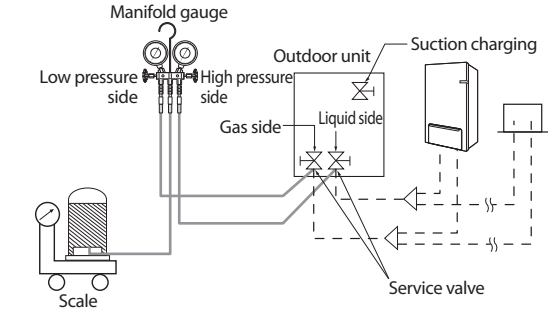

* Adding refrigerants in heating conditions

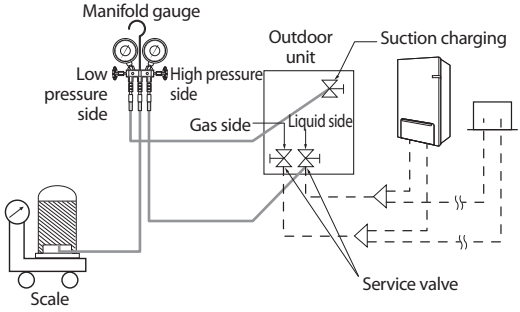

- Connect the manifold gauge and purge the manifold gauge.
- Open the manifold gauge valve of the liquid side service valve and add the liquid refrigerant.
- If you cannot fully recharge the additional refrigerant while the outdoor unit is stopped, use the key on the outdoor unit PCB to recharge the remaining refrigerant.
- Adding the cooling refrigerant
  1) Press the function key for adding refrigerant in cooling mode.
  2) After 20 minutes of operation, open the valve on gas side.
  3) Open the valve for low pressure side on the manifold gauge to recharge the remaining refrigerant.
- Adding the heating refrigerant
  1) When recharging the heating refrigerant, connect the low pressure pipe from manifold gage to the suction charging port.
  2) Press the function key for adding refrigerant in heating mode.
  3) After 20 minutes of operation, open the valve on suction charge port.
  4) Open the valve for low pressure side on the manifold gage to recharge the remaining refrigerant.

CAUTION

- Open the gas side and liquid side service valve completely after charging the refrigerant. (If you operate the Air to Water Heat Pump with the service valve closed, the important parts may be damaged.)

Refrigerant piping work

To close the valve stem

1. Open the cap and turn the valve stem clockwise by using a hexagonal wrench.

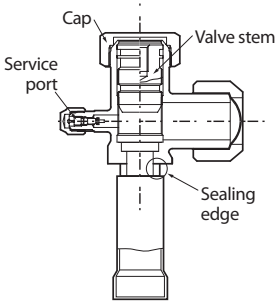

2. Tighten the valve stem until it reached the sealing edge.

NOTE
- Do not apply excessive force to the valve stem and always use special instruments. Otherwise, the contact surface between valve stem and sealing edge can be damaged and refrigerant can leak through this damaged surface.
- If refrigerant would leak, turn the valve stem back by half and tighten the valve stem again, then check the leakage. If there is no leakage any more, tighten the valve stem entirely.

3. Tighten the cap securely.

To open the valve stem

1. Remove the cap.
2. Turn the valve stem counterclockwise by using a hexagonal wrench.
3. Turn the valve stem until it is stopped.
4. Tighten the cap securely.

CAUTION
- When you use the service port, always use a charging hose, too.
- Check the leakage of refrigerant gas after tightening the cap.
- Must use a spanner and wrench when you open/tighten the valve stem.

Checking correct grounding

If the power distribution circuit does not have a grounding or the grounding does not comply with specifications, an grounding electrode must be installed. The corresponding accessories are not supplied with the air conditioner.

1. Select an grounding electrode that complies with the specifications given in the illustration.

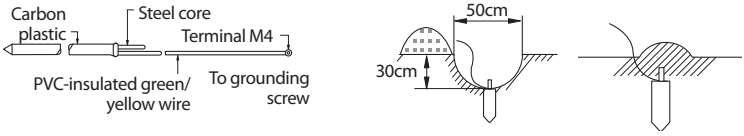

2. Connect the flexible hose to the flexible hose port.

- ► In damp hard soil rather than loose sandy or gravel soil that has a higher grounding resistance.
- ► Away from underground structures or facilities, such as gas pipes, water pipes, telephone lines and underground cables.
- ► At least two metres away from a lightening conductor grounding electrode and its cable.

NOTE • The grounding wire for the telephone line cannot be used to ground the air conditioner.

3. Finish wrapping insulating tape around the rest of the pipes leading to the outdoor unit.
4. Install a green/yellow coloured grounding wire :

- ► If the grounding wire is too short, connect an extension lead, in a mechanical way and wrapping it with insulating tape (do not bury the connection).
- ► Secure the grounding wire in position with staples.

NOTE • If the grounding electrode is installed in an area of heavy traffic, its wire must be connected securely.

5. Carefully check the installation, by measuring the grounding resistance with a ground resistance tester. If the resistance is above required level, drive the electrode deeper into the ground or increase the number of grounding electrodes.
6. Connect the grounding wire to the electrical component box inside of the outdoor unit.

Setting the option switch and function of the keys

Testing operations

1. Check the power supply between the outdoor unit and the auxiliary circuit breaker.
   - 1 phase power supply : L, N
2. Check the Indoor unit
   1) Check that you have connected the power and communication cables correctly. (If the power cable and communication cables one mixed up or connected incorrectly, the PCB will be damaged.)
   2) Check the temp. sensor, water pump, and display are connected correctly.
3. Press K1 or K2 on the outdoor unit PCB to run the test mode and stop.

KEY	KEY operation	7-segment display
K1	Press once : Heating test run	"H" "1" "BLANK" "BLANK"
	Press twice : Defrost test run	"H" "3" "BLANK" "BLANK"
	Press 3times : Finishing test mode	-
K2	Press once : Cooling test run	"C" "2" "BLANK" "BLANK"
	Press twice : Finishing test mode	-
K3	Reset	
K4	View mode	Refer to View mode display

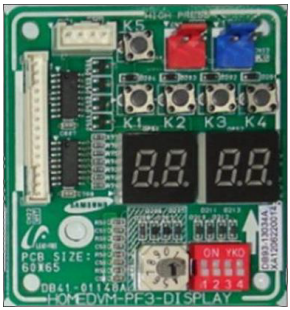

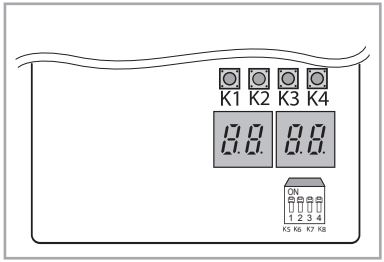

4. View Mode : When the K4 switch is pressed, you can see information about our system state as below.

Number of press	Display contents	Display				Units
		Segment 1	Segment 2	Segment 3	Segment 4	
0	Communication State	10s digit of Tx	1s digit of Tx	10s digit of Rx	1s digit of Rx	
1	Order frequency	1	100s digit	10s digit	1s digit	Hz
2	Current frequency	2	100s digit	10s digit	1s digit	Hz
3	Type of Outdoor unit (Mono/Split)	3	0	0	0 : split 1 : mono	
4	Outdoor air sensor	4	+ / -	10s digit	1s digit	℃
5	Discharge sensor	5	100s digit	10s digit	1s digit	℃
6	PHE (Eva) sensor	6	+ / -	10s digit	1s digit	℃
7	Cond sensor	7	+ / -	10s digit	1s digit	℃
8	Current	8	10s digit	1s digit	First decimal	A
9	Fan RPM	9	1000s digit	100s digit	10s digit	rpm

Number of press	Display contents	Display				Units
		Segment 1	Segment 2	Segment 3	Segment 4	
10	Target discharge temperature	A	100s digit	10s digit	1s digit	℃
11	EEV	B	100s digit	10s digit	1s digit	step
12	Not used exchanger capacity	C	0	0	0	kW
13	Protection control	D	0 : air conditioning 1 : heating	Protection control 0 : no protection control 1 : freezing 2 : non-stop defrosting 3 : over-load 4 : discharge	Frequency state 0 : Normal 1 : Hold 2 : Down 3 : Up_limit 4 : Down_limit	-
14	Temperature of Heatsink at PBA	E	100s digit	10s digit	1s digit	℃
15	The Quantity of connected Indoor Unit	F	100s digit	10s digit	1s digit	set
long-1	Main Micom version	Year(Hex)	Month(Hex)	Day(two digit)	Day(One digit)	-
long-1and 1	Inverter Micom version	Year(Hex)	Month(Hex)	Day(two digit)	Day(One digit)	-
long-1and 2	EEPROM version	Year(Hex)	Month(Hex)	Day(two digit)	Day(One digit)	-

5. DIP Switching setting

KEY	ON (default)	OFF	Remark
Switch 1	Auto Address (Outdoor unit recognize the address of indoor unit by random access.)	Manual Address (Outdoor unit recognize the address of indoor unit by rotary switch of indoor unit.)	Switch 1 must be'ON'
Switch 2	Anti-stack snow mode OFF	Anti-stack snow mode ON	
Switch 3	x		Not defined
Switch 4	x		Not defined

Pump down procedure

Objective of pump down

For product repairs and indoor unit relocation, pump down operation must be done recover the refrigerant into the outdoor unit.

Cautions when performing pump down

- ▶ Product limits amount of refrigerant in the outdoor unit due to slim design.
- ▶ Collect the majority of the refrigerant in the system in an empty refrigerant vessel and perform a pump down operation with remaining refrigerant. Maximum amount of refrigerant is 5Kg.
- ▶ If the amount of refrigerant exceeds maximum allowable limit, increased pressure may cause compressor trip or a burn out.

Cautions when performing pump down

1. Close the manifold gauge.
2. Close the liquid side service valve.
3. Press the K2 button on the outdoor unit PCB one time. (H2 will be displayed on outdoor unit PCB LED.)
4. Observe low pressure side using manifold gauge when the compressor moves.
5. When the pressure on low pressure side decrease below 0 MPa(0 kgf/cm^2) close the gas side service valve and end the pump down operation. (To end the pump down operation, press the K2 button once more or press K3 button to reset.)

CAUTION

- Use a transfer cylinder when recovering refrigerant to be reused. Using modified refrigerant vessel may cause explosion and cause damage or personal injury.

NOTE

Relocation of the Air to water heat pump

- Refer to this procedure when the unit is relocated.
- Carry out the pump down procedure. (Refer to the details of 'pump down'.)
- Collecting refrigerant may be hard, since multi type products exceeds allowable charging amount of refrigerant in the outdoor unit to support long piping. (Refer to page 31.)
- Remove the power cord.
- Disconnect the assembly cable from the indoor and outdoor units.
- Remove the flare nut connecting the indoor unit and the pipe.
- At this time, cover the pipe of the indoor unit and the other pipe using a cap or vinyl plug to avoid foreign material entering.
- Disconnect the pipe connected to the outdoor unit. At this time, cover the valve of the outdoor unit and the other pipe using a cap or vinyl plug to avoid foreign material entering.
- Make sure you do not bend the connection pipes in the middle and store together with the cables.
- Move the indoor and outdoor units to a new location.
- Remove the mounting plate for the indoor unit and move it to a new location.

Collecting refrigerant in refrigerant vessel before pump down operation

If the amount of refrigerant in the system exceeded the maximum allowable limit, reduce the amount of the refrigerant by following the below instruction before pump down operation.

1. Prepare an exclusive rechargeable refrigerant vessel, scale and a manifold gauge.
2. Check the amount of refrigerant in the entire system.
3. Connect a refrigerant vessel to an outdoor unit and operated about 50% of the indoor unit in cooling mode.
4. After 10 minutes of cooling operation, check the pressure on high pressure side with the manifold gauge. If the pressure on the high pressure side is over 3.0 MPa (30.59 kgf/cm^2) reduce the number of operating indoor unit to decrease the pressure below 3.0 MPa (30.59 kgf/cm^2).
5. When the pressure becomes lower than 3.0 MPa (30.59 kgf/cm^2) open the manifold gauge valve ② which is connected to a liquid side. Then, open the valve on the refrigerant vessel for the refrigerant to flow from the liquid side pipe to a vessel.
6. Check the weight difference with the scale. When desired amount of the refrigerant is collected into the vessel, close the valve and remove the manifold gauge.
7. Make sure that the amount of the refrigerant in the vessel is about 50% of the entire system.
8. Measure the amount of refrigerant correctly to not exceed amount of collected refrigerant.

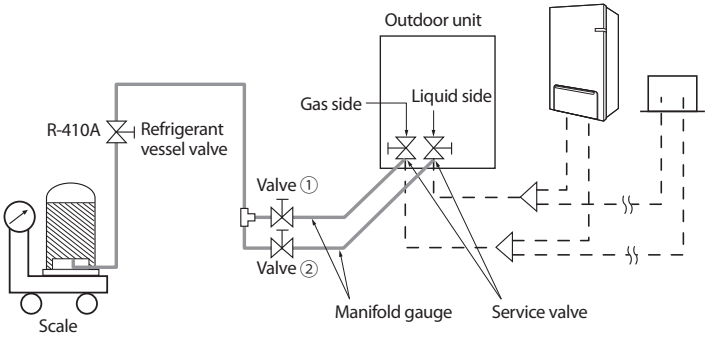

Pump down procedure

When refrigerant recovery is difficult due to the large amount of refrigerant

1. Prepare manifold gauge, scale and an empty refrigerant vessel.
2. As shown below, connect the middle hose of manifold gauge to the refrigerant vessel and then connect the both ends of manifold gauge to the outdoor unit service valve individually. (Valve of refrigerant vessel and Low pressure side valve must be closed and the high pressure side valve must be open.)
3. Start refrigerant recovery operation by pressing K2 button one time.
4. After operating for 10 minutes, open the valve of refrigerant vessel and fill it with refrigerant.
5. Close the valve of refrigerant vessel when sufficient refrigerant is filled.
6. Close the liquid service valve immediately. When the low pressure falls down lower than 0, close the gas service valve.
7. Stop the operation by pressing reset button.

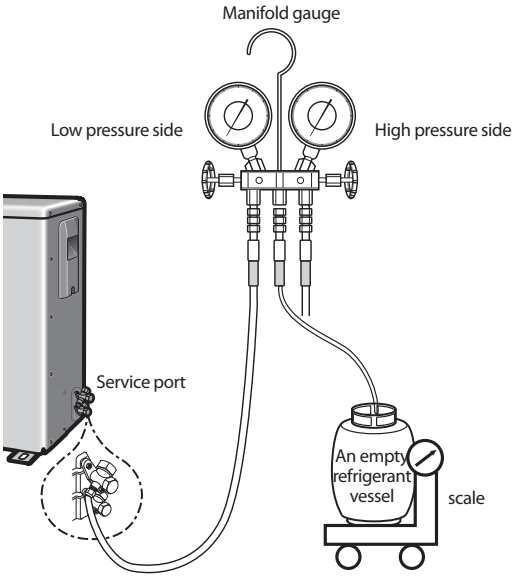

Completing the installation

► Check the following after completing the installation.

Installation	Outdoor unit	• Check the external surface and the inside of the outdoor unit. • Is there any possibility of short circuit? • Is the place well-ventilated and ensures space for service? • Is the outdoor unit fixed securely?
	Indoor unit	• Check the external surface and the inside of the indoor unit. • Is the place well-ventilated and ensures space for service? • Check if the center of the indoor unit is ensured and it is installed horizontally.
Adding refrigerant		• Is total number of connecting indoor units in the allowable range? • Are the length and the difference between the refrigerant pipes within the allowable range? • Is the Y-joint properly installed? • Is the pipe properly insulated? • Is the quantity of the additional refrigerant correctly weighed in?
Installing the drain pipe		• Check the drain pipe of the outdoor unit and the indoor unit. • Have you completed the drain test? • Is the drain pipe properly insulated?
Installing the wiring		• Have you performed the earthing work 3 to the outdoor unit? • Is 2-core cable used? • Is the length of the wire is in the limited range? • Is the wiring route correct?
Setting ADDRESS		• Are the ADDRESSES of the indoor and outdoor unit properly set?

Final checks and trial operation

Turn on the outdoor unit 3 hours before the test operation to preheat the compressor. If the compressor is not preheated, 'CH' will appear on the outdoor unit PCB.

Inspection before test operation

1. Check the power cable and communication cable of the indoor and outdoor unit.
2. Check the power supply between the outdoor unit and the cabinet panel.
   - Check the 220-240V~ with the voltage meter.
3. Once the outdoor unit is turned on, it performs the tracking to check the connected indoor unit and options.

Test operation

1. Run the unit by KEY MODE or controller.
   - 1st- Running a indoor units by KEY MODE.
     2nd- Each indoor unit runs separately by controller.
   - Inspect the compressor sound during the initial operation. If roaring sound is heard, stop operation.
2. Check the indoor and outdoor units' running status.
   - Check if back light of remocon to be lighten by pushing the buttons without any error codes
   - Indoor and outdoor unit's abnormal running noise.
   - Check detail running status using S-NET program.
3. Finish test.
4. Explain to the customer how to use the Air to Water Heat Pump following the user's manual.

Filling out the installation check card and storing it inside of the outdoor unit

- ► The installation check card is enclosed in the installation manual.
- ► Installation engineer should fill out the installation card honestly.
  - Basic contents such as installation date, name of engineer, contact number, service company, etc.
  - Additional contents such as model name of outdoor unit, remarks, refrigerant calculation due to additional pipe, etc.
  - Contents related indoor unit such as the place where indoor unit is installed, model name of indoor unit, etc.
- ► Store the installation check card inside of the outdoor unit and make sure not to lose it.



Trouble shooting

WARNING

- Incorrect handling of thermostat, safety valve or other valves may lead to tank rupture. When servicing the unit follow instructions carefully:
- Always turn off main power supply when water supply is being shut off.
- Test the free operation of the safety valve regularly by opening the valve ensuring the water flows freely.
- Electrical connection and all servicing of the electrical components should only be carried out by an authorized electrician.
- Fitting and all servicing of plumbing fixtures should only be carried out by an authorized installer.
- When replacing the thermostat, safety valve or any other valve or part supplied with this unit, use only approved parts of the same specification.

Error codes

If the unit has some problems and does not work normally, error code is shown on the OUTDOOR UNIT main PBA or LCD of the wired remote controller.

Display	Explanation	Error Source
101	Hydro-Unit / OUTDOOR UNIT wire connection error	HYDRO UNIT, OUTDOOR UNT
162	EEPROM Error	HYDRO UNIT
201	Hydro-Unit/OUTDOOR UNIT communication error (Matching error)	HYDRO UNIT, OUTDOOR UNT
202	Hydro-Unit/OUTDOOR UNIT communication error (3 min)	HYDRO UNIT, OUTDOOR UNT
203	Communication error between MAIN and SUB PBA	OUTDOOR UNIT
221	OUTDOOR UNIT air temperature sensor error	OUTDOOR UNIT
231	Condenser temperature sensor error	OUTDOOR UNIT
251	Discharge temperature sensor error	OUTDOOR UNIT
320	OLP sensor error	OUTDOOR UNIT
403	Detection of OUTDOOR UNIT compressor freezing (During cooling operation)	OUTDOOR UNIT
404	Protection of OUTDOOR UNIT when it is overload (during Safety Start, Normal operation state)	OUTDOOR UNIT
416	Discharge of a compressor is overheated	OUTDOOR UNIT
419	OUTDOOR UNIT EEV operation error	OUTDOOR UNIT
425	Power source line missing error (only for 3-phase model)	OUTDOOR UNIT
440	Heating operation blocked (outdoor temperature over 35°C)	OUTDOOR UNIT
441	Cooling operation blocked (outdoor temperature under 9°C)	OUTDOOR UNIT
458	OUTDOOR UNIT fan error	OUTDOOR UNIT
461	[Inverter] Compressor startup error	OUTDOOR UNIT
462	[Inverter] Total current error/PFC over current error	OUTDOOR UNIT
463	OLP is overheated	OUTDOOR UNIT
464	[Inverter] IPM over current error	OUTDOOR UNIT

Error codes

Display	Explanation	Error Source
465	Compressor overload error	OUTDOOR UNIT
466	DC LINK over/low voltage error	OUTDOOR UNIT
467	[Inverter] Compressor rotation error	OUTDOOR UNIT
468	[Inverter] Compressor sensor error	OUTDOOR UNIT
469	[Inverter] DC LINK voltage sensor error	OUTDOOR UNIT
470	EEPROM read/write error	OUTDOOR UNIT
471	[Inverter] OTP error	OUTDOOR UNIT
474	IPM(IGBT Module) or PFCM temperature sensor Error	OUTDOOR UNIT
484	PFC Overload Error	OUTDOOR UNIT
485	Input current sensor error	OUTDOOR UNIT
500	IPM is overheated	OUTDOOR UNIT
554	Gas leak error	OUTDOOR UNIT
601	Communication error between the Hydro-Unit and wired remote controller	HYDRO UNIT
602	Wired remote controller Master/Slave setting error	HYDRO UNIT
604	Communication tracking error between the Hydro-Unit and wired remote controller	HYDRO UNIT
607	Communication error between the Master and Salve wired remote controllers	HYDRO UNIT
901	Water inlet (PHE) temperature sensor error(open/short)	HYDRO UNIT
902	Water outlet (PHE) temperature sensor error(open/short)	HYDRO UNIT
903	Water outlet (backup heater) temperature sensor error	HYDRO UNIT
904	DHW tank temperature sensor error	HYDRO UNIT
906	Refrigerant gas inlet (PHE) temperature sensor (open/short)	HYDRO UNIT
911	Flow switch and water pump error (F/S signal is OFF for 10 sec. during the water pump signal is ON)	HYDRO UNIT
912	Flow switch and water pump error (Water pump signal is OFF for 60sec during the F/S signal is ON)	HYDRO UNIT

SAMSUNG

AEX060EDEHA

Air to Water Heat Pump Outdoor Unit

installation manual

Planet First 100% Recycled Paper

This manual is made with 100% recycled paper.

imagine the possibilities

Thank you for purchasing this Samsung product.
To receive more complete service, please register your product at

www.samsung.com/register

ⒺⓈⒻⒾⓅⒹ DB68-03338A-1

SAMSUNG